


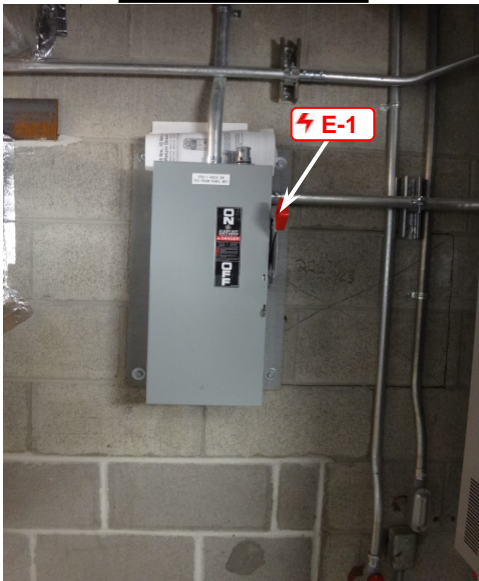
LOCKOUT/TAGOUT PROCEDURE OSHA CFR 1910.147

Developed by	Reviewed by	Revised by
RA	RA	
Description: Air Handler Unit		Equipment #: ERU-1
Building: Thompson Arena	Area: Mechanical Room	Revn: 0
Date: N/A	Origin Date: 12/18/2017	


10 	Isolation Points to be Locked and Tagged	DANGER
		Confined Space. Obtain proper permits and follow confined space procedure prior to entering. Variable-frequency-drive capacitors often remain energized after shut-down. Discharge and wait 10 minutes prior to servicing. Pressurized refrigeration loop to be serviced by authorized personnel only.

Safety Is Your Responsibility!





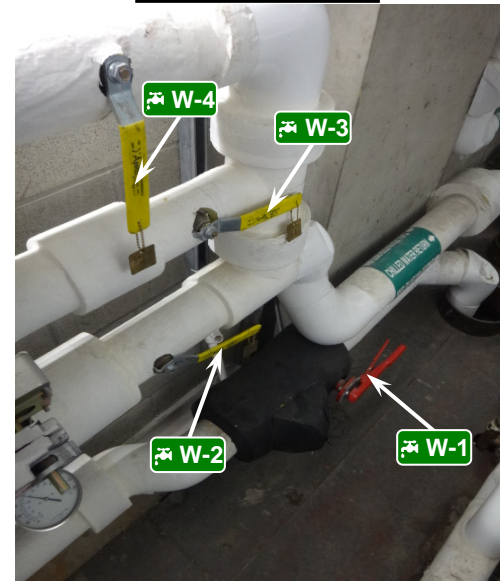


South Side View



North Side View



ALWAYS PERFORM A MACHINE STOP BEFORE LOCKING OUT DISCONNECTS

ID	Source	Device	Location	Method	Check
	Electrical 480V	Padlock	Isolation point on North side of unit.	Move electrical disconnect to off. Lock out.	Verify machine is deenergized.
	Chilled Water Inlet - 100 PSI	Padlock	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
	Chilled Water Outlet - 100 PSI	Ball valve device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
	Chilled Water Outlet - 100 PSI	Ball valve device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
	Chilled Water Outlet - 100 PSI	Ball valve device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
	Thermal Energy 300 F		Be sure to wait until heat has dissipated from machine until cool to touch before servicing. Wear proper PPE before beginning work.		
	Kinetic Energy 1800 RPM		Be sure to wait until all moving parts have come to a complete stop. If necessary, use a block or chain to prevent equipment from moving while servicing.		




OPENING A GUARD DOES NOT CONSTITUTE A LOCKOUT
ALWAYS VERIFY DE-ENERGIZATION OF EXPOSED ELECTRICAL PARTS AND RESIDUAL CAPACITANCE

Any machine modifications must be shown in procedure.
Contact EHS to update procedure: 603-646-1762



Developed by	Reviewed by	Revised by
RA	RA	

Description: Air Handler Unit		Equipment #: ERU-1	
Building: Thompson Arena	Area: Mechanical Room	Rev: 0	Date: N/A Origin Date: 12/18/2017


10  Isolation Points to be Locked and Tagged	DANGER
	Confined Space. Obtain proper permits and follow confined space procedure prior to entering. Variable-frequency-drive capacitors often remain energized after shut-down. Discharge and wait 10 minutes prior to servicing. Pressurized refrigeration loop to be serviced by authorized personnel only.

Safety Is Your Responsibility!






South Side View

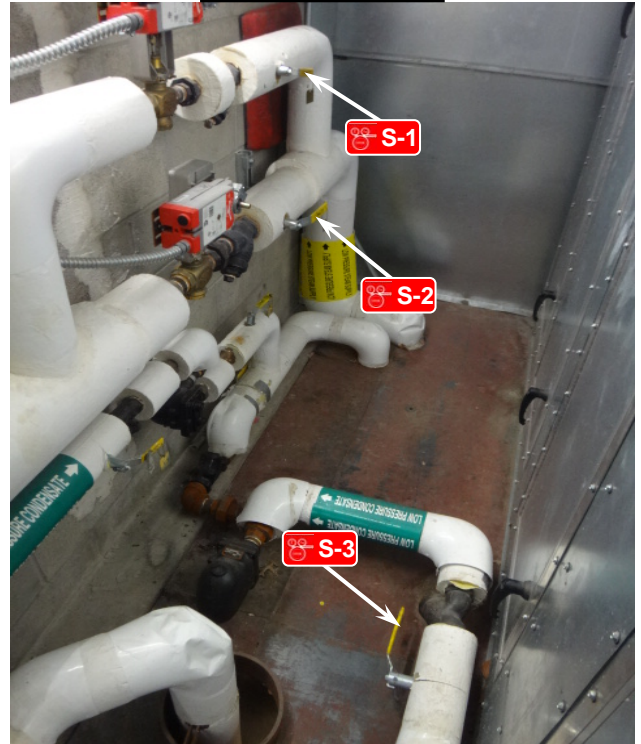

North Side View



ALWAYS PERFORM A MACHINE STOP BEFORE LOCKING OUT DISCONNECTS

ID	Source	Device	Location	Method	Check
 W-5	Hot Water Inlet - 100 PSI	Ball valve device	Isolation point on West side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
 W-6	Hot Water Inlet - 100 PSI	Ball valve device	Isolation point on West side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
 S-1	Steam Inlet - 20 PSI	Ball valve device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
 S-2	Steam Inlet - 20 PSI	Ball valve device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.
 S-3	Condensate Outlet - 20 PSI	Cable device	Isolation point on East side of unit.	Turn valve to closed position. Lock out.	Visually verify zero pressure status.



OPENING A GUARD DOES NOT CONSTITUTE A LOCKOUT
ALWAYS VERIFY DE-ENERGIZATION OF EXPOSED ELECTRICAL PARTS AND RESIDUAL CAPACITANCE

Any machine modifications must be shown in procedure.
Contact EHS to update procedure: 603-646-1762

